


This Turret Configuration Used On
 Vipros III 3510Z NT, Vipros III 3610Z NT

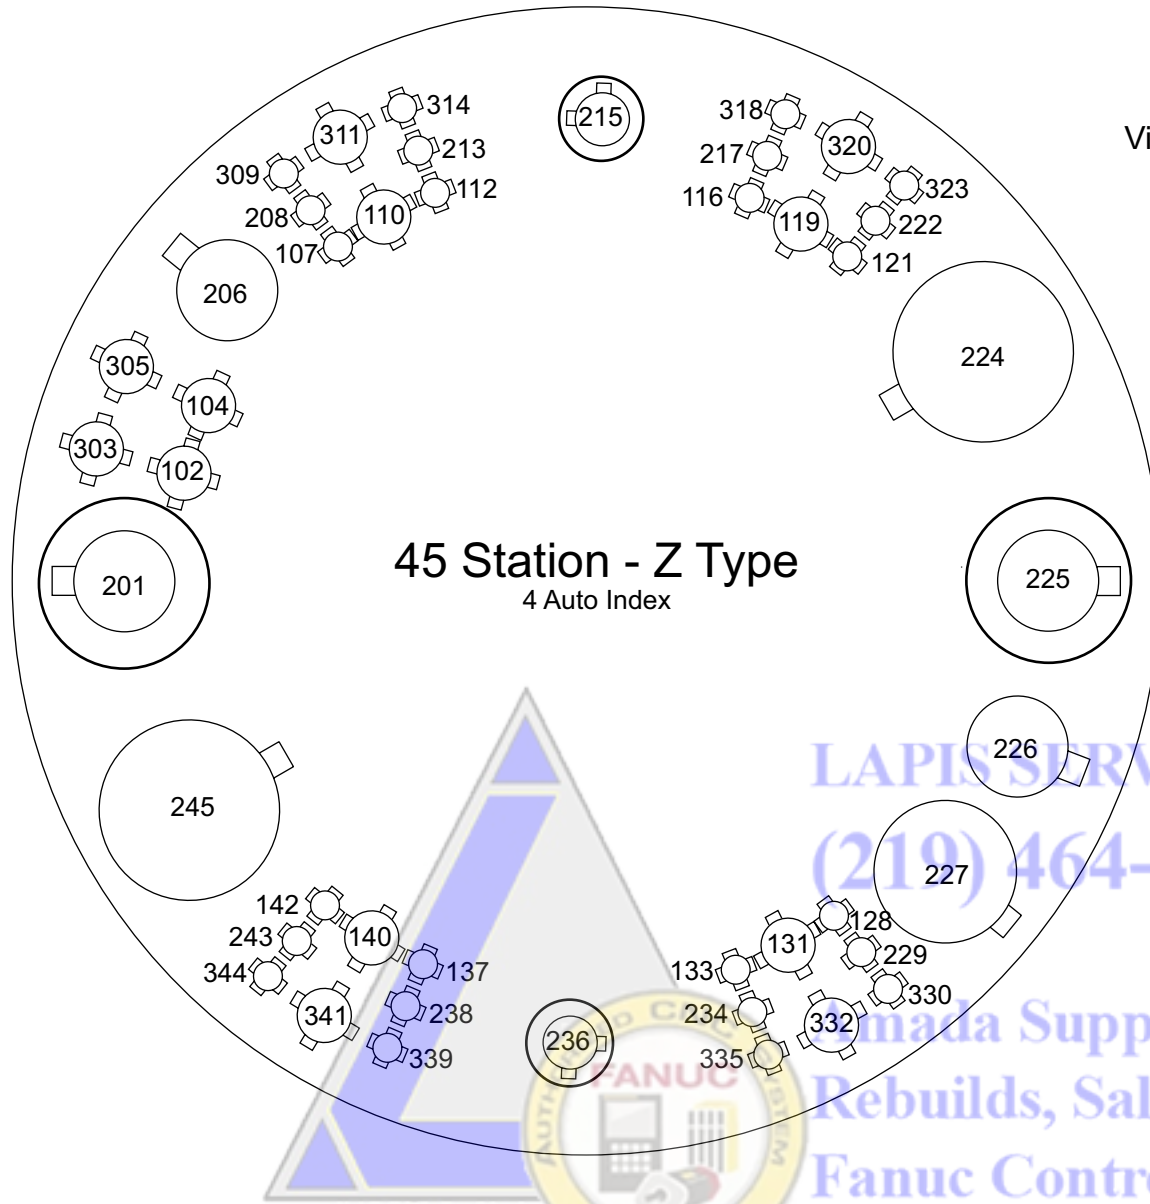

45 Station - Z Type
 4 Auto Index

	Maximum Size Round		Number Of Stations (Keyed)
A	½"	12.7mm	24 (24)
B	1¼"	31.7mm	12 (12)
C	2"	50.8mm	2 (2)
D	3½"	88.9mm	1 (1)
E	4½"	114.3mm	2 (2)
Auto Index	B	1¼"	2 (2)
	C	2"	2 (2)

LAPIS SERVICES
 (219) 464-9131

Canada Support,
 Rebuilds, Sales And
 Fanuc Control Upgrades.